

## Series LFII Residential 4.9 K-factor Concealed Pendent Sprinkler Flat Plate, Wet Pipe System

### IMPORTANT

Refer to Technical Data Sheet TFP2300 for warnings pertaining to regulatory and health information.

Always refer to Technical Data Sheet TFP700 for the "INSTALLER WARNING" that provides cautions with respect to handling and installation of sprinkler systems and components. Improper handling and installation can permanently damage a sprinkler system or its components and cause the sprinkler to fail to operate in a fire situation or cause it to operate prematurely.

Scan the QR code or enter the URL in a web browser to access the most up-to-date electronic version of this document. Data rates may apply.



[docs.jci.com/tycofire/tpf446](https://docs.jci.com/tycofire/tpf446)

### General Description

The TYCO Series LFII Residential 4.9K Concealed Pendent Sprinklers (TY2534) are decorative, glass bulb sprinklers, available in both ordinary 155°F (68°C) and intermediate 200°F (93°C) temperature rated configurations. They are designed for use in residential occupancies such as homes, apartments, dormitories, and hotels.

The cover plate assembly conceals the sprinkler operating components above the ceiling. The flat profile of the cover plate provides the optimum aesthetically appealing sprinkler design. In addition, the concealed design of

the Series LFII Residential Concealed Pendent Sprinklers provides 3/4 in. (19,1 mm) vertical adjustment. This adjustment provides a measure of flexibility when cutting fixed sprinkler drops.

The Series LFII Residential Concealed Pendent Sprinklers are intended for use in the following scenarios:


- Wet pipe residential sprinkler systems for one and two family dwellings and mobile homes per NFPA 13D
- Wet pipe residential sprinkler systems for residential occupancies up to and including four stories in height per NFPA 13R
- Wet pipe sprinkler systems for the residential portions of any occupancy per NFPA 13

The Series LFII Residential Concealed Pendent Sprinklers have been designed with heat sensitivity and water distribution characteristics proven to help in the control of residential fires and to improve the chance for occupants to escape or be evacuated.

The Series LFII Residential Concealed Pendent Sprinklers (TY2534) are shipped with a disposable protective cap. The protective cap is temporarily removed for installation, and then it can be replaced to help protect the sprinkler while the ceiling is being installed or finished. The tip of the protective cap can also be used to mark the center of the ceiling hole into the plaster board, ceiling tiles, or other covering material, by gently pushing the ceiling product against the protective cap. When the ceiling installation is complete the protective cap is removed and the cover plate assembly is installed.

### NOTICE

*The Series LFII Residential Concealed Pendent Sprinklers (TY2534) described herein must be installed and maintained in compliance with this document and with the applicable standards of the NATIONAL FIRE PROTECTION ASSOCIATION (NFPA), in addition to the standards of any authorities having jurisdiction. Failure to do so may impair the performance of these devices.*

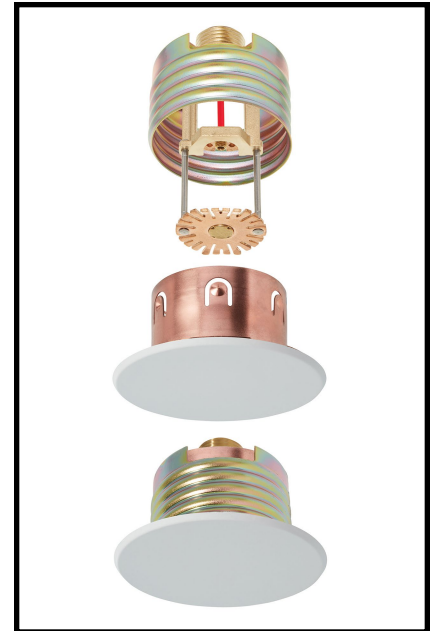

*The owner is responsible for maintaining their fire protection system and devices in proper operating condition. Contact the installing contractor or product manufacturer with any questions.*

### Sprinkler Identification Number (SIN)

TY2534

### Technical Data

#### Approvals

UL and C-UL Listed  
Australian WaterMark Certified

The TYCO Series LFII Residential Concealed Pendent Sprinklers are Listed only when installed with LFII Concealed Cover Plates having factory-applied finishes.

**Note:** Sprinklers and cover plates are separately ordered. For more information, see the Ordering Procedure section.

#### Maximum Working Pressure

175 psi (12,1 bar)

| Maximum Coverage Area <sup>1</sup><br>ft x ft<br>(m x m) | Maximum Spacing<br>ft<br>(m) | Temperature Rating            | WET PIPE SYSTEM<br>Minimum Flow and Residual Pressure <sup>2, 3</sup> |                          |                                                                                                                                               |                      |                              |
|----------------------------------------------------------|------------------------------|-------------------------------|-----------------------------------------------------------------------|--------------------------|-----------------------------------------------------------------------------------------------------------------------------------------------|----------------------|------------------------------|
|                                                          |                              |                               | Flow<br>gpm<br>(Lpm)                                                  | Pressure<br>psi<br>(bar) | Deflector-to-Ceiling<br>Distance                                                                                                              | Installation<br>Type | Minimum Spacing<br>ft<br>(m) |
| 12 x 12<br>(3,7 x 3,7)                                   | 12<br>(3,7)                  | 155°F (68°C),<br>200°F (93°C) | 13<br>(49,2)                                                          | 7.0<br>(0,48)            | Smooth Ceilings<br>9/16 in. to 1-5/16 in.<br>(14,3 mm to 33,3 mm)                                                                             | Concealed            | 8<br>(2,4)                   |
| 14 x 14<br>(4,3 x 4,3)                                   | 14<br>(4,3)                  |                               | 13<br>(49,2)                                                          | 7.0<br>(0,48)            |                                                                                                                                               |                      |                              |
| 16 x 16<br>(4,9 x 4,9)                                   | 16<br>(4,9)                  |                               | 13<br>(49,2)                                                          | 7.0<br>(0,48)            | Beamed Ceilings per<br>NFPA 13D or 13R, or 13.<br>Installed in beam<br>9/16 in. to 1-5/16 in.<br>(14,3 mm to 33,3 mm)<br>below bottom of beam |                      |                              |
| 18 x 18<br>(5,5 x 5,5)                                   | 18<br>(5,5)                  |                               | 17<br>(64,3)                                                          | 12.0<br>(0,83)           |                                                                                                                                               |                      |                              |
| 20 x 20<br>(6,1 x 6,1)                                   | 20<br>(6,1)                  |                               | 20<br>(75,7)                                                          | 16.7<br>(1,15)           |                                                                                                                                               |                      |                              |

**Notes:**

1. For coverage area dimensions less than or between those indicated, use the minimum required flow for the next highest coverage area for which hydraulic design criteria are stated.
2. Requirement is based on minimum flow in gpm (Lpm) from each sprinkler. The associated residual pressures are calculated using the nominal K-factor. See Hydraulic Design under the Design Criteria section.
3. For NFPA 13 residential applications, the greater of 0.1 gpm/ft<sup>2</sup> over the design area or the flow in accordance with the criteria in this table must be used.

**TABLE A**  
**WET PIPE SYSTEM**  
**SERIES LFII RESIDENTIAL 4.9 K-FACTOR FLAT PLATE CONCEALED PENDENT SPRINKLER (TY2534)**  
**NFPA 13D, 13R, AND 13 HYDRAULIC DESIGN CRITERIA**

**Discharge Coefficient**

K=4.9 gpm/psi<sup>1/2</sup> (70,6 Lpm/bar<sup>1/2</sup>)

**Temperature Rating**

**Ordinary**

155°F (68°C) Sprinkler  
139°F (59°C) Cover Plate

**Note:** Maximum Ambient Ceiling Temperature for the ordinary temperature configuration is 100°F (38°C).

**Intermediate**

200°F (93°C) Sprinkler  
165°F (74°C) Cover Plate

**Note:** Maximum Ambient Ceiling Temperature for the intermediate temperature configuration is 150°F (65°C).

**Vertical Adjustment**

3/4 in. (19,1 mm)

**Finishes**

See the Ordering Procedure section


**Physical Characteristics**

Frame ..... Brass  
Support Cup ..... Plated Steel  
Guide Pins ..... Stainless Steel  
Deflector ..... Bronze  
Compression Screw ..... Brass  
Bulb ..... Glass  
Button ..... Phosphor Bronze  
Sealing Assembly ..... Beryllium Nickel w/TEFLON  
Cover Plate ..... Brass  
Retainer ..... Plated Steel  
Cover Plate Ejection Spring ..... Stainless Steel  
Bridge ..... Bronze


## Operation

When exposed to heat from a fire, the cover plate, normally soldered to the retainer at three points, falls away to expose the sprinkler/support cup assembly.

The deflector, supported by the guide pins, then drops down to its operated position.

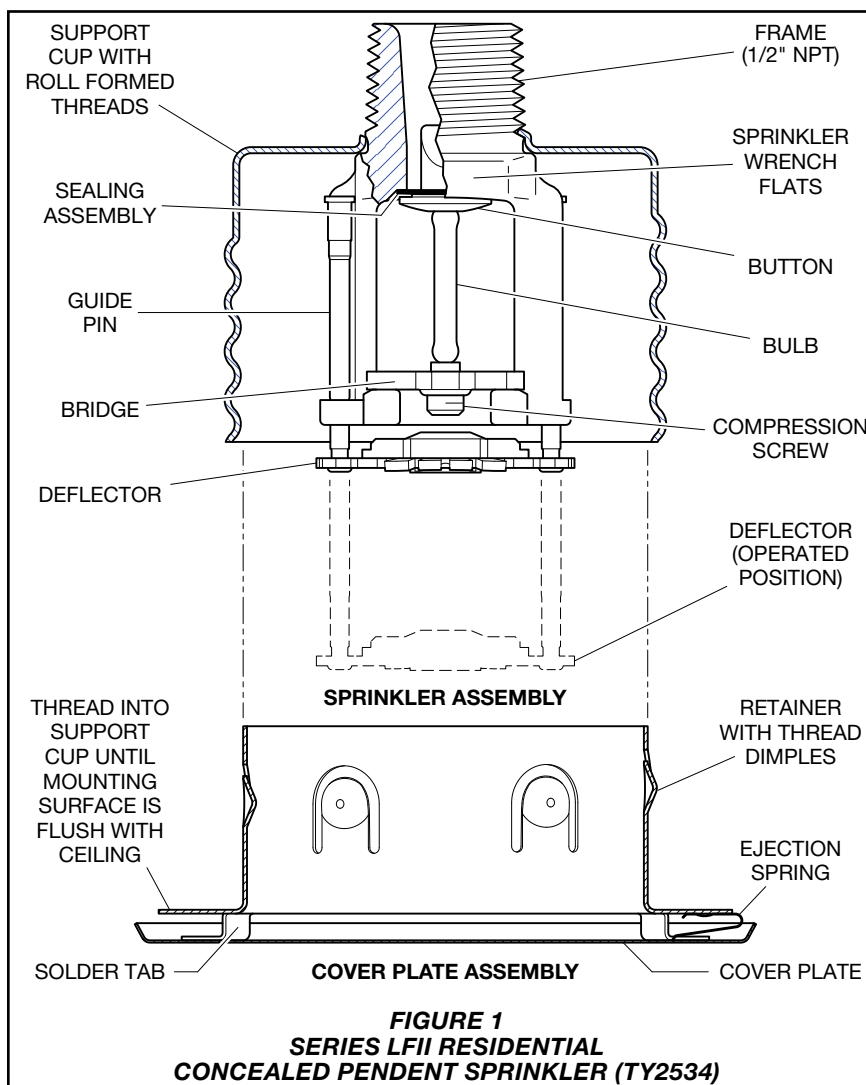

**FIGURE 1**  
**SERIES LFII RESIDENTIAL**  
**CONCEALED PENDENT SPRINKLER (TY2534)**

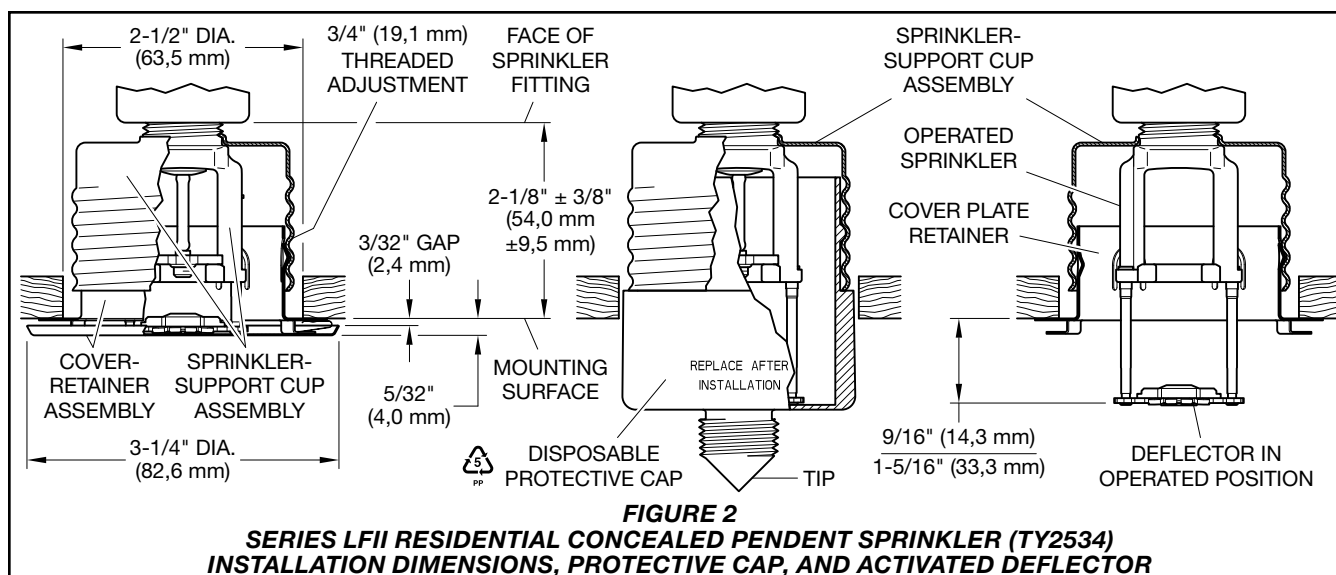

The glass bulb contains a fluid that expands when exposed to heat. When the rated temperature is reached, the fluid expands sufficiently to shatter the glass bulb, activating the sprinkler and allowing water to flow.

## Design Criteria

The TYCO Series LFII Residential Concealed Pendent Sprinklers (TY2534) are UL and C-UL Listed for installation in accordance with this section.

**Note:** When conditions exist that are outside the scope of the provided criteria, refer to the *Residential Sprinkler Design Guide TFP490* for the manufacturer's recommendations that may be acceptable to the authority having jurisdiction.

### Ceiling Types

Smooth flat horizontal, beamed, or sloped in accordance with NFPA 13D, 13R, or 13 as applicable.

### Hydraulic Design (NFPA 13D and 13R)

For systems designed to NFPA 13D or NFPA 13R, the minimum required sprinkler flow rates are given in Table A as a function of temperature rating and the maximum allowable coverage areas.

The sprinkler flow rate is the minimum required discharge from each of the total number of design sprinklers as specified in NFPA 13D or NFPA 13R.

### Hydraulic Design (NFPA 13)

For systems designed to NFPA 13, the number of design sprinklers is to be the four most hydraulically demanding sprinklers. The minimum required discharge from each of the four sprinklers is to be the greater of the following:

- Flow rates given in Table A as a function of temperature rating and the maximum allowable coverage area
- Minimum discharge of 0.1 gpm/ft<sup>2</sup> over the design area comprised of the four most hydraulically demanding sprinklers for actual coverage areas protected by the four sprinklers

### Obstruction to Water Distribution

Sprinklers are to be located in accordance with the obstruction rules of NFPA 13D, 13R, and 13 as applicable for residential sprinklers as well as with the obstruction criteria described within the Technical Data Sheet TFP490.

### Operational Sensitivity

The sprinklers are to be installed relative to the ceiling mounting surface as shown in Figure 2.

### Sprinkler Spacing


The minimum spacing between sprinklers is 8 ft (2,4 m). The maximum spacing between sprinklers cannot exceed the length of the coverage area (see Table A) being hydraulically calculated, for example, maximum 12 ft (3,7 m) for a 12 ft x 12 ft (3,7 m x 3,7 m) coverage area, or 20 ft (6,1 m) for a 20 ft x 20 ft (6,1 m x 6,1 m) coverage area.

The Series LFII must not be used in applications where the air pressure above the ceiling is greater than that below. Down drafts through the support cup could delay sprinkler operation in a fire situation.

## Installation

### NOTICE

The sprinkler must be installed in neutral or negative pressure plenums only.

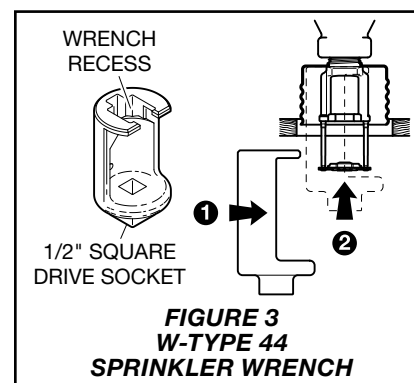

The TYCO Series LFII Residential Concealed Pendent Sprinklers (TY2534) must be installed in accordance with this section.

### General Instructions

Do not install any bulb-type sprinkler if the bulb is cracked or there is a loss of liquid from the bulb. With the sprinkler held horizontally, a small air bubble should be present.

A 1/2 in. NPT sprinkler joint should be obtained with a minimum to maximum torque of 7 lb-ft to 14 lb-ft (9,5 N·m to 19,0 N·m). Higher levels of torque may distort the sprinkler inlet with consequent leakage or impairment of the sprinkler.

Do not attempt to compensate for insufficient adjustment in the cover plate assembly by under- or over-tightening the sprinkler. Readjust the position of the sprinkler fitting to suit.

**Step 1.** The sprinkler must only be installed in the pendent position and with the centerline of the sprinkler perpendicular to the mounting surface.

**Step 2.** Remove the protective cap.

**Step 3.** With pipe thread sealant only.

applied to the pipe threads and using the W-Type 44 Wrench shown in Figure 3, position the wrench recess to first straddle the deflector guide pins from the side and then push the wrench into the support cup to engage the sprinkler wrench flats. Rotate clockwise to tighten the sprinkler-support cup assembly into the fitting. The W-Type 44 Wrench will accept a 1/2 in. ratchet drive.

**Note:** Do not engage the sprinkler frame arms by the wrench, engage only the sprinkler wrench flats.

**Step 4.** Replace the protective cap by pushing it upwards until it bottoms out against the support cup. The protective cap helps prevent damage to the deflector and guide pins during ceiling installation and during application of the finish coating of the ceiling. It may also be used to locate the center of the clearance hole by gently pushing the ceiling material against the center point of the cap.

**Note:** As long as the protective cap remains in place, the system is considered to be OUT OF SERVICE.

**Step 5.** After the ceiling has been completed with the 2 1/2 in. (63 mm) diameter clearance hole and in preparation for installing the cover plate assembly, remove and discard the protective cap, and verify that the deflector moves up and down freely.

If the sprinkler has been damaged and the deflector does not move up and down freely, replace the entire sprinkler assembly. Do not attempt to modify or repair a damaged sprinkler.

**Step 6.** Push on the cover plate assembly until its flange comes in contact with the ceiling.

Do not continue to push on the cover plate assembly such that it lifts a ceiling panel out of its normal position.

If the cover plate assembly cannot be engaged with the mounting cup or the cover plate assembly cannot be engaged sufficiently to contact the ceiling, the sprinkler fitting must be repositioned.

## Care and Maintenance

The TYCO Series LFII Residential Concealed Pendent Sprinklers (TY2534) must be maintained and serviced in accordance with this section.

Before closing a fire protection system main control valve for maintenance work on the fire protection system which it controls, permission to shut down the affected fire protection

system must be obtained from the proper authorities and all personnel who may be affected by this action must be notified.

Absence of a cover plate may delay the sprinkler operation in a fire situation.

When properly installed, there is an air gap between the lip of the cover plate and the ceiling. The cover plate assembly has a nominal 3/32 in. (2,4 mm) air gap, as shown in Figure 2. This air gap is necessary for proper operation of the sprinkler by allowing heat flow from a fire to pass below and above the cover plate to help assure appropriate release of the cover plate in a fire situation. If the ceiling is to be repainted after the installation of the sprinkler, care must be exercised to ensure that the new paint does not seal off any of the air gap.

Factory painted cover plates must not be repainted. They should be replaced, if necessary, by factory painted units. Non-factory applied paint may adversely delay or prevent sprinkler operation in the event of a fire.

Do not pull the cover plate relative to the enclosure. Separation may result.

Sprinklers which are found to be leaking or exhibiting visible signs of corrosion must be replaced.

Automatic sprinklers must never be painted, plated, coated, or otherwise altered after leaving the factory. Modified or over heated sprinklers must be replaced.

Care must be exercised to avoid damage before, during, and after installation. Sprinklers damaged by dropping, striking, wrench twist/slippage, or the like, must be replaced.

The owner is responsible for the inspection, testing, and maintenance of their fire protection system and devices in compliance with this document, as well as with the applicable standards of the NATIONAL FIRE PROTECTION ASSOCIATION such as NFPA 25, in addition to the standards of any other authorities having jurisdiction. Contact the installing contractor or product manufacturer with any questions.

The owner must assure that the sprinklers are not used for hanging any objects and that the sprinklers are only cleaned by means of gently dusting with a feather duster; otherwise, non-operation in the event of a fire or inadvertent operation may result.

Automatic sprinkler systems should be inspected, tested, and maintained by a qualified Inspection Service in accordance with local requirements and/or national codes.

## Limited Warranty

For warranty terms and conditions, visit [www.tyco-fire.com](http://www.tyco-fire.com).

## Ordering Procedure

Contact your local distributor for availability. When placing an order, indicate the full product name and part number (P/N).

### Sprinkler Assemblies

Specify: Series LFII (TY2534) 4.9K Residential Concealed Pendent Sprinkler, P/N (specify):

155°F (68°C) ..... 51-549-1-155  
200°F (93°C) ..... 51-549-1-200

**Note:** Sprinkler and Cover Plates are separately sold. See below for Cover Plate ordering information.

### Cover Plate Assemblies

Specify: LFII Concealed Sprinkler Cover Plate Assembly, temperature rating (specify), finish (specify), P/N (specify):

#### 139°F (59°C)

Ivory (RAL1015) ..... 56-891-0-135  
Bright Chrome ..... 56-891-9-135B  
Beige (RAL1001) ..... 56-891-2-135  
Pure White (RAL9010)\* ..... 56-891-3-135  
Signal White (RAL9003)\*\* ..... 56-891-4-135  
Grey White (RAL9002) ..... 56-891-5-135  
Brown (RAL8028) ..... 56-891-6-135  
Black (RAL9005) ..... 56-891-7-135  
Brushed Brass ..... 56-891-8-135  
Brushed Chrome ..... 56-891-9-135  
Custom Paint ..... 56-891-X-135

#### 165°F (74°C)

Ivory (RAL1015) ..... 56-891-0-165  
Bright Chrome ..... 56-891-9-165B  
Beige (RAL1001) ..... 56-891-2-165  
Pure White (RAL9010)\* ..... 56-891-3-165  
Signal White (RAL9003)\*\* ..... 56-891-4-165  
Grey White (RAL9002) ..... 56-891-5-165  
Brown (RAL8028) ..... 56-891-6-165  
Black (RAL9005) ..... 56-891-7-165  
Brushed Brass ..... 56-891-8-165  
Brushed Chrome ..... 56-891-9-165  
Custom Paint ..... 56-891-X-165

\* Eastern Hemisphere sales only

\*\* Previously known as Bright White

**Note:** All custom cover plates are painted using SHERWIN-WILLIAMS Interior Latex Paint. Contact Johnson Controls Customer Service with any questions related to custom orders.

### Sprinkler Wrench

Specify: W-Type 44 Sprinkler Wrench, P/N 56-000-1-077